


ELEVATION
NOT TO SCALE

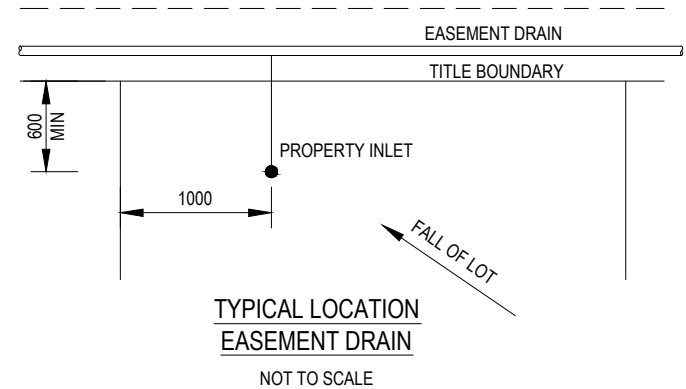

NOTES:

1. TYPE D PROPERTY CONNECTION, ONLY APPLICABLE WHERE PIPE HAS LESS THAN 750mm COVER.
2. ALL PROPERTY CONNECTION PIPES AND FITTINGS TO BE OF 100mm PVC SEWER CLASS SN6, REFER AS 1260.
3. ALL PVC JOINTS TO BE SEALED WITH SOLVENT CEMENT OR RUBBER RING JOINTS.
4. DEPTH 'D' = 400mm MINIMUM UNLESS APPROVED BY COUNCIL.
5. BED PROPERTY CONNECTION PIPE ON 50mm COMPACTED 20mm CLASS 3 CRUSHED ROCK OR CLASS 3 CRUSHED CONCRETE. BACKFILL TO 100mm ABOVE PIPE WITH 20mm CLASS 3 CRUSHED ROCK OR CLASS 3 CRUSHED CONCRETE.
6. BACKFILL TRENCH WITH CLASS 3 20mm CRUSHED ROCK OR CLASS 3 20mm CRUSHED CONCRETE TO 100mm ABOVE THE PROPERTY BOUNDARY CONNECTION IN EASEMENTS AND UNPAVED AREAS AND TO SUBGRADE LEVEL UNDER FOOTPATHS OF UNPAVED AREAS
7. ALL DIMENSIONS IN MILLIMETRES.
8. NOT APPLICABLE TO MELBOURNE WATER CORPORATION DRAINAGE ASSETS. FOR MWC WORKS REFER TO MWC LAND DEVELOPMENT MANUAL.

No	Revision	Note: * indicates signatures on original issue of drawing or last revision of drawing	Drawn	Checked	Approved	Date
0	FINAL ISSUE		DG	MM	-	16.11.15

Plot Date: 16 November 2015 - 4:27 PM Plotted by: Kerry Walton

Cad File No: Q:\Infrastructure Planning\EDCM Standard Drawings\EDCM - 704.dwg



STANDARD DRAWINGS FOR
SUBDIVISIONS IN GROWTH AREAS
**PROPERTY INLET
TYPE D**

Revision | 0
Date | DEC 2015
EDCM 704