


END VIEW

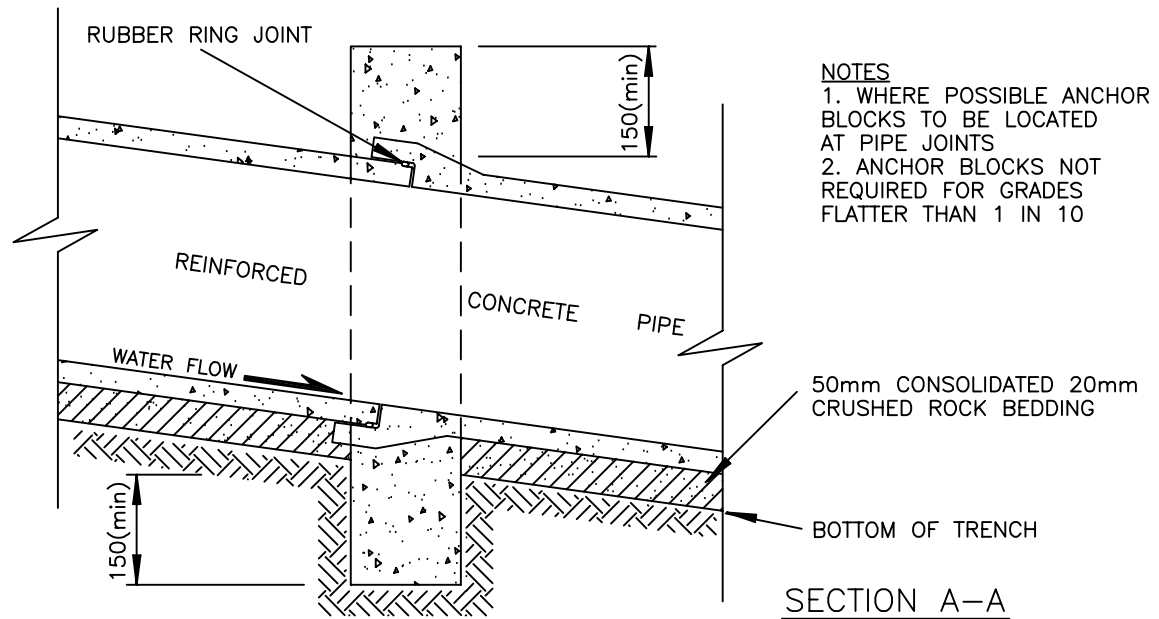

- NOTES**
1. WHERE POSSIBLE ANCHOR BLOCKS TO BE LOCATED AT PIPE JOINTS
  2. ANCHOR BLOCKS NOT REQUIRED FOR GRADES FLATTER THAN 1 IN 10

**ANCHOR BLOCK SPACING**

BASED ON THE RULE THAT 1 IS REQUIRED PER 2.5m RISE

GRADE	MAX SPACING	GRADE	MAX SPACING
1 in 1	2.5	1 in 6	15.0
1 in 2	5.0	1 in 7	17.5
1 in 3	7.5	1 in 8	20.0
1 in 4	10.0	1 in 9	22.5
1 in 5	12.5	1 in 10	25.0

**NOTE**  
PITS ARE REGARDED AS ANCHOR BLOCKS. NO EXTENSION OF SPACING WILL BE PERMITTED.

City of Whittlesea	
STANDARD ANCHOR BLOCK	SD 214
APPROVED	REVISION DATE July 2001