


NOT TO SCALE

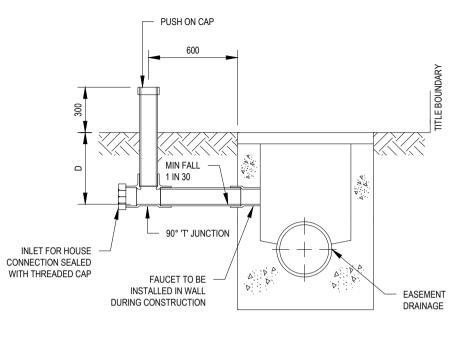

EASEMENT DRAINAGE ELEVATION

NOT TO SCALE

NOTES:

- 1. ALL PIPES AND FITTINGS TO BE OF 100mm PVC CLASS SN6, REFER AS 1260.
- 2. ALL PVC JOINTS TO BE SEALED WITH SOLVENT CEMENT OR RUBBER RING JOINTS.
- 3. DEPTH 'D' = 400mm MINIMUM UNLESS APPROVED BY COUNCIL.
- 4. BED PROPERTY CONNECTION PIPE ON 50MM COMPACTED 20mm CLASS 3 CRUSHED ROCK OR CLASS 3 CRUSHED CONCRETE.
- BACKFILL TRENCH WITH CLASS 3 20mm CRUSHED ROCK OR CLASS 3 20mm CRUSHED CONCRETE TO 100mm ABOVE THE PROPERTY CONNECTION PIPE IN EASEMENTS AND UNPAVED AREAS AND TO SUBGRADE LEVEL UNDER FOOTPATHS AND PAVED AREAS.
- 6. TRENCH UNDER FOOTPATH TO BE BACKFILLED WITH COMPACTED 20MM CLASS 3 CRUSHED ROCK.
- 7. IF THE HOLE IN THE PIT WALL FOR THE PIPE IS NOT AVAILABLE, A HOLE IS TO BE CORE DRILLED.
- 8. ALL DIMENSIONS IN MILLIMETRES OR AS NOTED OTHERWISE.
- 9. REFER TO EDCM 605-609 FOR PIT DETAILS.

